

# IJAI 2022

*By* Bhakti Suprpto

---

WORD COUNT

4038

TIME SUBMITTED

16-JUL-2022 09:59AM

PAPER ID

88460525

## Indonesian load prediction estimation using long short term memory

**4 Erliza Yuniarti<sup>1,4</sup>, Siti Nurmaini<sup>2</sup>, Bhakti Yudho Suprpto<sup>3</sup>**

<sup>1</sup>Doctoral Program of Engineering Science, Faculty of Engineering Universitas Sriwijaya, Palembang, Indonesia

<sup>2</sup>Intelligenet Research Group, Univ. Sriwijaya, Palembang, Indonesia

<sup>3</sup>Department of Electrical Engineering, Universitas Sriwijaya, Palembang, Indonesia

<sup>4</sup>Department of Electrical Engineering, Faculty of Engineering, Universitas Muhammadiyah Palembang, Palembang, Indonesia

### Article Info

#### Article history:

Received Oct 21, 2021

Revised Jun 9, 2022

Accepted Jun 18, 2022

#### Keywords:

Detrending

Load forecasting

Long short term memory

One-day forecasting

### ABSTRACT

Prediction of electrical load is important because it relates to the source of power generation, cost-effective generation, system security, and policy on continuity of service to consumers. This paper uses Indonesian primary data compiled based on data log sheet per hour of transmission operators. In preprocessing data, detrending technique is used to eliminate outlier data in time series dataset. The prediction used in this research is a long-short-term memory algorithm with stacking and time-step techniques. In order to get the optimal one-day forecasting results, the inputs are arranged in the previous three periods with 1, 2, 3 layers, 512 and 1024 nodes. Forecasting results obtained long short-term memory (LSTM) with three layers and 1024 nodes got mean average percentage error (MAPE) of 8.63 better than other models.

*This is an open access article under the CC BY-SA license.*



### Corresponding Author:

**4 Erliza Yuniarti**

Doctoral Program of Engineering Science, Faculty of Engineering, Universitas Sriwijaya

St. Palembang-Prabumulih KM. 32 Kabupaten Ogan Ilir, Sumatera Selatan, Indonesia

Email: erlizay69@gmail.com

## 1. INTRODUCTION

Electrical load forecasting in the electric power industry is important because it relates to the management of generating sources, cost-effective power system planning, system security, customer service and policy making [1, 2]. Electrical load forecasting research is based on past load patterns [3] which may reappear in the future. Load forecasting can be classified based on the length of the horizon and the method used. Load forecasting can be classified based on the length of the horizon and the method used [4]. Based on the length of the forecasting horizon [5], [6] long-term forecasts of 1 year or more, medium-term 1 week to 1 year, and short-term 1 hour to 1 week. Based on the load forecasting method, the statistical method is used with a mathematical approach based on correlation regression, while the machine learning and deep learning methods are built based on the training and testing process to train and test the performance of the model. The advantage of the deep learning model is that it is more efficient to train complex neural networks, with generalization capabilities that increase accuracy around 20-45% [7]. Among the three learning methods, deep learning techniques are the most successful methods in the field of image, text and data mining [8].

Several studies using deep learning methods for load forecasting include using the convolutional neural network (CNN) neural network method, where the CNN layer is used to extract features from historical loads in homogeneous residential load clustering [9], [10]. Recurrent neural network (RNN) architecture in load forecasting supports non-stationary discrete time input signals, making RNNs more suitable for sequential or sequential data [11]–[13]. Long-short term memory (LSTM) by combining

short-term memory with long-term memory, through gate control prevents signal loss during the prediction process, so as to a better accuracy [14]–[16]. Gate recurrent unit (GRU) is applied in the demand side energy forecasting which is still limited [17], predict electrical power load [18], shows the prediction performance of GRU is still lower than LSTM, but better than traditional models.

Modeling in particular with time-series data sets using the LSTM technique is quite popular for solving complex sequence models such as electrical loads, by studying long-term dependencies and tracking patterns that occurred far in the past. Several studies using the LSTM algorithm have been developed for short-term electrical load forecasting and become the best algorithm for prediction for time series data [5], [16], [19]–[22]. According to [16], [21] the vital problem in forecasting models using the LSTM structure is to choose the right sequence of lag times along with the right hyperparameter model for certain time series data. Electric load prediction based on one day ahead [19] using supervised learning k-Means technique for the classification of consumer features based on the time sequence, namely adjacent times; adjacent day; and the same day of the adjacent week. The experimental result [19], [23] shows that the hyperparameter tuning of variations in the number of nodes in the parallel layer LSTM shows good accuracy performance, and overall LSTM performance can find energy consumption patterns from consumers. Kwon *et al.* [5] applying the short-term forecasting method by extracting features from historical data, with the separation of features, namely the day of the week, the average load of the last two days, the hourly load and the hourly temperature so as to get good accuracy for forecasting the electricity load one day ahead in Korea. The recent research [20] uses a half-hour period data set from 2008-2016 from metropolitan France for one-day forecasting. Bou *et al.* [20] discusses the optimal configuration of the LSTM model by tuning the hyperparameter of the number of layers, the number of neurons in each layer, lag time, batch size, and type of activation so as to reduce the complexity of the dataset used. Abdel-Nasser and Mahmoud [22] comparing the basic LSTM architecture, LSTM with sliding windows technique, LSTM with time steps and stacked LSTMs with other benchmark models in modeling temporal changes in photo voltaic (PV) output power per hour in Egypt. The architecture of all LSTMs outperforms benchmark models for one-hour predictions ahead, and LSTM architectures with time steps get the lowest error compared to all other LSTM architectures.

The research in this paper proposes to predict the short-term load one day ahead with the stacking technique and the LSTM time step which is used for planning operations at the load control center one day ahead. This study uses a primary load dataset of Indonesia's electrical energy consumption, which until now is still limited. The dataset is compiled from PT PLN's daily logsheet based on the records of the transmission system operator every hour, for five years, 2013-2017. In preliminary research [24] our validation shows that LSTM-based forecasting models outperform other alternative approaches. Based on this preliminary research, we developed an LSTM algorithm by setting the optimal lag time and time step which is integrated with 3 layers LSTM stacking. To get the predictive performance of the electrical load it is measured using the mean absolute error (MAE) and the mean absolute percentage error (MAPE). The rest of this article is structured: Part 2 of the research methodology, provides an overview of building prediction techniques that we propose. Section 3 describes the experimental results, validation and comparing with other LSTM models and deep learning models. Section 4 draws conclusions from the research that has been done.

## 2. RESEARCH METHOD

In this section, a short-term forecasting methodology for the next one day will be explained using the LSTM algorithm. We propose a three-step framework, namely, dataset preparation and preprocessing, LSTM algorithm construction and comparison machine learning (ML) algorithm, LSTM algorithm training and validation. In the following, we present an overview of the methodology, and an explanation for each component of the methodology in detail from the Indonesian electricity consumption dataset in this case study.

### 2.1. Data preparation and preprocessing

Forecasting this electrical load uses sequential data, which is related to past values. Past data on the use of electrical energy represents trends and load patterns as well as anomalies that occur. An exploratory analysis of the electrical load time series can be useful for identifying trends, patterns, and anomalies. Consumption patterns are grouped into daily, monthly and yearly electrical load consumption so that a graphical correlation can be seen between time and electricity usage.

#### 2.1.1. Dataset

To find out the pattern of electricity consumption contained in this dataset, it is shown in Figures 1-3, the graph depicts the electricity load per day, per month and per year. Due to it is sequentially every hour, the total data in each year consists of 365 days or 8670 data. The daily load profile for 24 hours is shown in Figure 1, load consumption has an upward trend starting from 08.00 hours to its peak at

11.00-15.00 hours and decreases again along with reduced population activity. The peak load occurred at 18.00-20.00 with an increase in the load in housing and industry consisting of lighting and electronic equipment (65% of the load was housing load). Load consumption was reduced until the next following morning. From Figure 2, the hourly electricity consumption for one month obtained a lot of load outlier data in a few hours, the anomaly causes weather or human errors, and will be overcome by preprocessing the load before being used as input for the machine learning model. In addition, Figure 3 illustrates the electrical consumption for one year. It infers that in the beginning of year, the electrical load slightly fluctuates. However, in the next following segment (middle to end of year) the electrical consumption relatively steady.

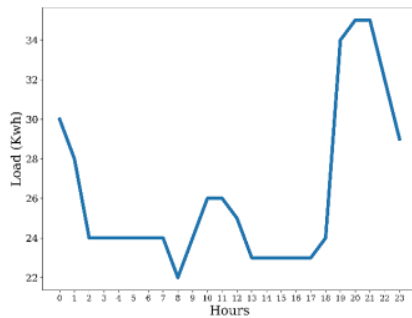


Figure 1. Twenty-four-hour electrical load

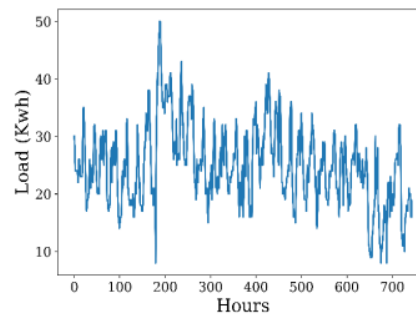


Figure 2. Monthly daily electrical load

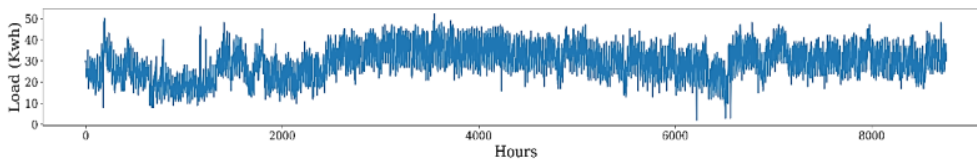


Figure 3. Yearly electrical load

Forecasting electrical load data in this study is a short-term forecast. The data used is the electrical load per hour on the same day. For example, to predict the electrical load on Monday, the model reference data from the previous Monday. In order to compose the input data using historical value, the previous three periods was used. The use of too much historical data can cause multicollinearity problems so that the prediction results of the model become less sensitive. Figure 4 shows the process of data reshaping as input for the LSTM model.



Figure 4. The used of three historical data period to forecast one next period

**25**  
**2.1.2. Data pre-processing**

The dataset used in this study comes from Indonesian data from 2013-2017, from operator data recording of the high-voltage overhead line transmission system. In research using univariant datasets, we

only use active power (MW) i.e. power usage or electricity consumption and reduce other data in the transmission operator's records. Furthermore, data pre-processing consists of imputing missing value, detrending to remove distortion in the form of an increase or decrease from normalized time series data. Detrending is a process that aims to remove trends from the time series. The trend usually refers to the average change over time. When performing the detrending process, aspects that may distort the data will be removed. Distortion in time series data can be seen as fluctuations in time-series graphs. By eliminating the distortion, the graph of the increase or decrease of the time series data can be seen. Figure 5(a) illustrates the raw data which contain an extreme fluctuation and may distort the training process. Thus, a detrending process was performed which is illustrated in Figure 5(b). In this study normalization changes the feature range into the range  $[-1, 1]$  because this range is suitable for use on data that has outliers. The results of the normalization stage are carried out in a pre-processing [23] stage, which is followed by data management, which includes data transformation and data splitting into training and testing data. Training and testing data are separated using an 80/20 ratio for training and testing respectively [25].

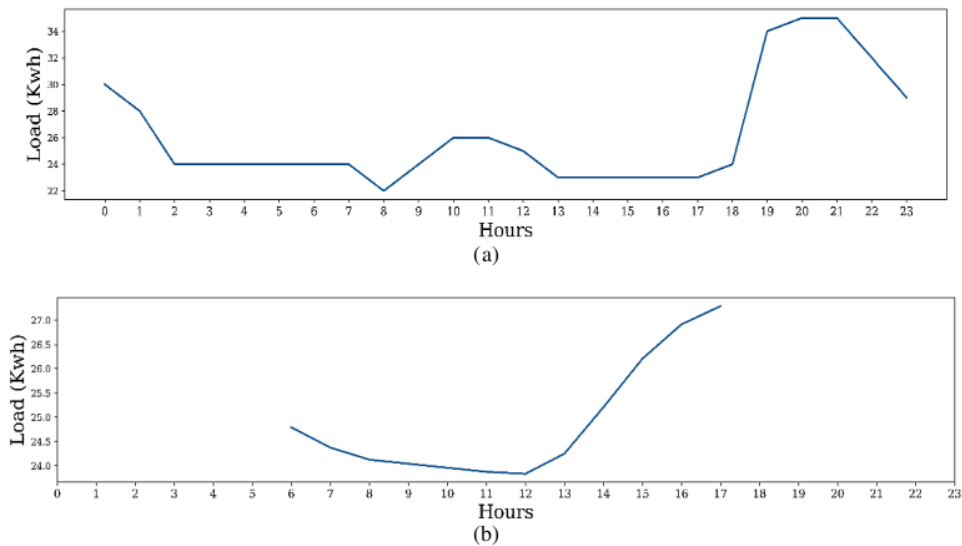


Figure 5. Illustrate (a) observed data (b) detrending result

## 27 2.2. Research methodology

In this study, the electrical load forecasting process was carried out using the deep learning method. The deep learning method used is RNN with LSTM architecture. The LSTM network is a development of the RNN architecture. RNN architecture is a network that works for sequence or time series data by considering the output (information) of the previous process and storing the information for a short time (short-term memory).

The LSTM architecture accepts input in the form of an  $X_t$  feature, where this feature is the value of the electrical load. This feature is then entered into the LSTM block for processing. The LSTM block receives input  $h_{t-1}$  (hidden state from the previous LSTM block),  $C_{t-1}$  (Cell state from the previous LSTM block), and  $X_t$  (feature input). The LSTM block also has outputs in the form of  $h_t$  and  $C_t$ , namely the current hidden state and the current cell state (memory). In addition, in the LSTM block there are sigmoid [18] tanh activation functions, which act as input gates, forget gates and output gates. Several parameters are used to tune the LSTM model, such as the number of nodes and hidden layers. Figure 6 shows the research methodology of this research.

## 2.3. Evaluation metrics

To measure the model's performance, an error rate was calculated using the MAPE. The lower the error rate, the higher the data accuracy. MAPE provides results in the form of absolute percentage averages with forecast errors compared to actual data.



$$MAPE = \frac{1}{N} \sum_{i=1}^N \frac{|Y_i - \hat{Y}_i|}{Y_i} \times 100$$

16 Where,  $N$  is number of samples,  $Y_i$  is actual value, and  $\hat{Y}_i$  is prediction value.

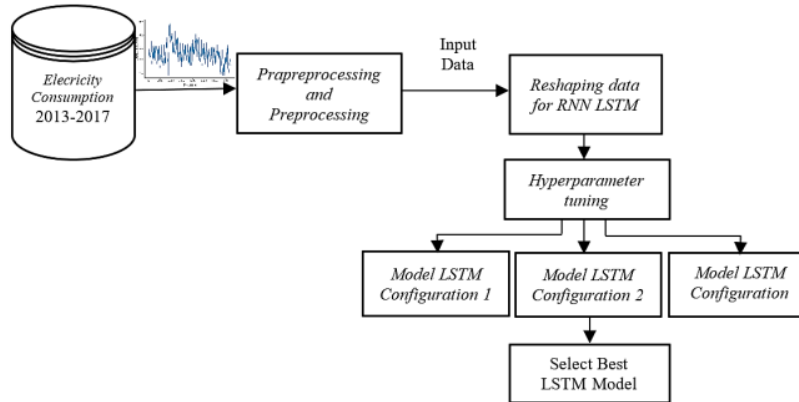


Figure 6. Research methodology

### 3. RESULTS AND DISCUSSIONS

In this study, testing was carried out with the distribution of the dataset of 80% for training data and validation data. Each dataset is trained using the LSTM model. The parameters used in this study include the number of hidden layers, the number of hidden nodes, the batch size of 4, epoch 100 and using the ADAM optimizer optimization method.

#### 3.1. LSTM 1 layer

In LSTM architecture, layer 1 has 512 and 1024 hidden units, with Adam optimizer, and loss function mean squared error (MSE). The number of epochs for this layer is 100 with a batch size of 4. Units in the input and output layers are 1 unit. While the number of parameters generated in the LSTM 1 layer architecture is 1,053,185 and 4,207,617 parameters for 512 and 1024 respectively. The results of the single layer LSTM test are shown in Table 1.

#### 3.2. LSTM 2 layers

In building 2 layers LSTM architecture, two LSTM blocks are stacked into one, thus forming a stack of LSTM blocks. The 2-layer LSTM architecture does not have much difference in the 1-layer LSTM architecture. Consists of 512 and 1024 hidden units, with Adam optimizer, and loss function MSE. The number of epochs and batch size for this layer is still the same, namely 100 and 4. Then the units in the input and output layers are 1 unit. However, because the number of layers is more, the parameters generated in the LSTM 2 layers architecture are also increased to 3,156,481 parameters for 512 nodes and 12,604,417 for 1024 nodes. The results of the two-layer LSTM test are shown in Table 2.

Table 1. LSTM one layer evaluation result

Node	MAPE	Parameters
512	9.37	1,053,185
1024	9.29	4,207,617

Table 2. LSTM two layers evaluation result

Node	MAPE	Parameters
512	9.28	3,156,481
1024	9.04	12,604,417

### 3.3. LSTM 3 layers

The 3 layers LSTM architecture is the same as the 2 layers LSTM architecture, but the number of stacks of LSTM blocks is 3 stacks. This architecture consists of 512 and 1024 hidden units, with the Adam optimizer, and the loss function MSE. The number of epochs and batch size for this layer is still the same, namely 100 and 4. Then the units in the input and output layers are 1 unit. However, because the number of layers is more, the parameters generated in this 3 layers LSTM architecture also increase to 5,257,729 parameters. The results of the three-layer LSTM test are shown in Table 3. In order to evaluate the model's ability to predict the forecasting pattern that has been carried out, we compared it with other models from the state of the art research [7] and [19], in the MAPE evaluation metrics which is summarized in Figure 7.

Table 3. LSTM three layers evaluation result

Node	MAPE	Parameters
512	9.13	5,257,729
1024	8.63	21,001,217

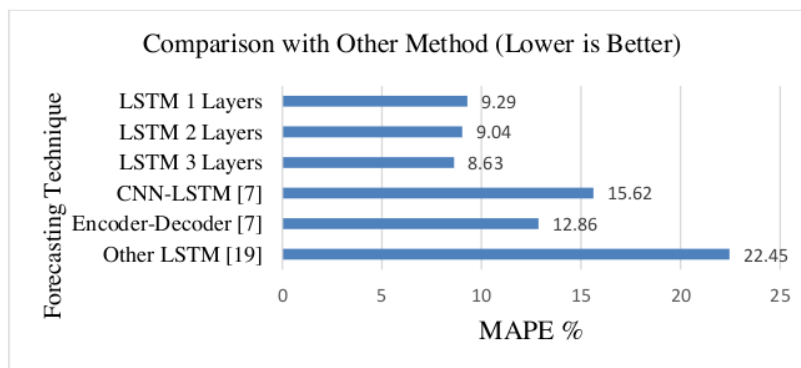


Figure 7. Comparison of MAPE value with other forecasting techniques (lower is better)

## 4. CONCLUSION

This study applies LSTM to predict the electrical load energy. Based on the experimental result the best architecture was LSTM three layers with 1024 nodes. It reaches 8.63 of MAPE value. The historical features used in this study was three previous period.

## REFERENCES





- [1] F. Li and G. Jin, "Research on power energy load forecasting method based on KNN," *International Journal of Ambient Energy*, vol. 43, no. 1, pp. 946–951, Dec. 2022, doi: 10.1080/01430750.2019.1682041.
- [2] Z. Wang, B. Zhao, H. Guo, L. Tang, and Y. Peng, "Deep ensemble learning model for short-term load forecasting within active learning framework," *Energies*, vol. 12, no. 20, p. 3809, Oct. 2019, doi: 10.3390/en12203809.
- [3] H. Shi, M. Xu, and R. Li, "Deep learning for household load forecasting—a novel pooling deep RNN," *IEEE Transactions on Smart Grid*, vol. 9, no. 5, pp. 5271–5280, Sep. 2018, doi: 10.1109/TSG.2017.2686012.
- [4] A. Ahmad, N. Javaid, A. Mateen, M. Awais, and Z. A. Khan, "Short-term load forecasting in smart grids: an intelligent modular approach," *Energies*, vol. 12, no. 1, p. 164, Jan. 2019, doi: 10.3390/en12010164.
- [5] B.-S. Kwon, R.-J. Park, and K.-B. Song, "Short-term load forecasting based on deep neural networks using LSTM layer," *Journal of Electrical Engineering and Technology*, vol. 15, no. 4, pp. 1501–1509, Jul. 2020, doi: 10.1007/s42835-020-00424-7.
- [6] Z. Guo, K. Zhou, X. Zhang, and S. Yang, "A deep learning model for short-term power load and probability density forecasting," *Energy*, vol. 160, pp. 1186–1200, Oct. 2018, doi: 10.1016/j.energy.2018.07.090.
- [7] G. Chitalia, M. Pipattanasompom, V. Garg, and S. Rahman, "Robust short-term electrical load forecasting framework for commercial buildings using deep recurrent neural networks," *Applied Energy*, vol. 278, p. 115410, Nov. 2020, doi: 10.1016/j.apenergy.2020.115410.
- [8] Y. Zhu, R. Dai, G. Liu, Z. Wang, and S. Lu, "Power market price forecasting via deep learning," in *IECON 2018-44th Annual Conference of the IEEE Industrial Electronics Society*, Oct. 2018, pp. 4935–4939, doi: 10.1109/IECON.2018.8591581.
- [9] K. Aurangzeb, M. Alhusein, K. Javaid, and S. I. Haider, "A pyramid-CNN based deep learning model for power load forecasting of similar-profile energy customers based on clustering," *IEEE Access*, vol. 9, pp. 14992–15003, 2021, doi: 10.1109/ACCESS.2021.3053069.
- [10] Acharya, Wi, and Lee, "Short-term load forecasting for a single household based on convolution neural networks using data augmentation," *Energies*, vol. 12, no. 18, p. 3560, Sep. 2019, doi: 10.3390/en12183560.
- [11] M. N. Fekri, H. Patel, K. Grolinger, and V. Sharma, "Deep learning for load forecasting with smart meter data: online adaptive

*Indonesian load prediction estimation using long short term memory (Erliza Yuniarti)*





- recurrent neural network," *Applied Energy*, vol. 282, p. 116177, Jan. 2021, doi: 10.1016/j.apenergy.2020.116177.
- [12] A. Rahman, V. Sri Kumar, and A. D. Smith, "Predicting electricity consumption for commercial and residential buildings using deep recurrent neural networks," *Applied Energy*, vol. 212, pp. 372–385, Feb. 2018, doi: 10.1016/j.apenergy.2017.12.051.
- [13] L. Sehovac and K. Grolinger, "Deep learning for load forecasting: sequence to sequence recurrent neural networks with attention," *IEEE Access*, vol. 8, pp. 36411–36426, 2020, doi: 10.1109/ACCESS.2020.2975738.
- [14] U. Ugurlu, O. Tas, and U. Gunduz, "Performance of electricity price forecasting models: evidence from Turkey," *Emerging Markets Finance and Trade*, vol. 54, no. 8, pp. 1720–1739, Jun. 2018, doi: 10.1080/1540496X.2017.1419955.
- [15] J. Lago, F. De Ridder, and B. De Schutter, "Forecasting spot electricity prices: Deep learning approaches and empirical comparison of traditional algorithms," *Applied Energy*, vol. 221, no. January, pp. 386–405, Jul. 2018, doi: 10.1016/j.apenergy.2018.02.069.
- [16] X. Tang, Y. Dai, T. Wang, and Y. Chen, "Short-term power load forecasting based on multi-layer bidirectional recurrent neural network," *IET Generation, Transmission and Distribution*, vol. 13, no. 17, pp. 3847–3854, Sep. 2019, doi: 10.1049/iet-gtd.2018.6687.
- [17] A. M. N. C. Ribeiro, P. R. X. do Carmo, I. R. Rodrigues, D. Sadok, T. Lynn, and P. T. Endo, "Short-term firm-level energy-consumption forecasting for energy-intensive manufacturing: a comparison of machine learning and deep learning models," *Algorithms*, vol. 13, no. 11, p. 274, Oct. 2020, doi: 10.3390/a13110274.
- [18] K. Ke, S. Hongbin, Z. Chengkang, and C. Brown, "Short-term electrical load forecasting method based on stacked auto-encoding and GRU neural network," *Evolutionary Intelligence*, vol. 12, no. 3, pp. 385–394, Sep. 2019, doi: 10.1007/s12065-018-00196-0.
- [19] R. Jiao, T. Zhang, Y. Jiang, and H. He, "Short-term non-residential load forecasting based on multiple sequences LSTM recurrent neural network," *IEEE Access*, vol. 6, pp. 59438–59448, 2018, doi: 10.1109/ACCESS.2018.2873712.
- [20] S. Bouktif, A. Fiaz, A. Ouni, and M. A. Serhani, "Multi-sequence LSTM-RNN deep learning and metaheuristics for electric load forecasting," *Energies*, vol. 13, no. 2, pp. 1–21, 2020, doi: 10.3390/en13020391.
- [21] S. Bouktif, A. Fiaz, A. Ouni, and M. A. Serhani, "Single and multi-sequence deep learning models for short and medium term electric load forecasting," *Energies*, vol. 12, no. 1, p. 149, Jan. 2019, doi: 10.3390/en12010149.
- [22] M. Abdel-Nasser and K. Mahmoud, "Accurate photovoltaic power forecasting models using deep LSTM-RNN," *Neural Computing and Applications*, vol. 31, no. 7, pp. 2727–2740, Jul. 2019, doi: 10.1007/s00521-017-3225-z.
- [23] W. Kong, Z. Y. Dong, Y. Jia, D. J. Hill, Y. Xu, and Y. Zhang, "Short-term residential load forecasting based on LSTM recurrent neural network," *IEEE Transactions on Smart Grid*, vol. 10, no. 1, pp. 841–851, Jan. 2019, doi: 10.1109/TSG.2017.2753802.
- [24] E. Yuniarti, N. Nurmaini, B. Y. Suprpto, and M. Naufal Rachmatullah, "Short term electrical energy consumption forecasting using RNN-LSTM," in *2019 International Conference on Electrical Engineering and Computer Science (ICECOS)*, Oct. 2019, pp. 287–292, doi: 10.1109/ICECOS47637.2019.8984496.
- [25] P. Dangei, *Statistics for machine learning: techniques for exploring supervised, unsupervised, and reinforcement learning models with python and R*. 2017.

## BIOGRAPHIES OF AUTHORS







**Erliza Yuniarti**     is currently a PhD student in Faculty of Engineering, Sriwijaya University. She gets a bachelor degree from electrical engineering major, Universitas Sriwijaya and get a master degree from Engineering Systems, Renewable Energy study program from Gadjah Mada University in 2012. Her research interest is electrical load study, renewable energy, distribution system, grounding and deep learning. She can contact at email: erlizay@yahoo.com.



**Siti Nurmaini**     is currently a professor in the Faculty of Computer Science, Universitas Sriwijaya. She was received her Master's degree in Control system, Institut Teknologi Bandung-Indonesia (ITB), in 1998, and the PhD degree in Computer Science, Universiti Teknologi Malaysia (UTM), at 2011. Her research interest, including Biomedical Engineering, Deep Learning, Machine Learning, Image Processing, Control Systems, and robotics. She can contact at email: siti\_nurmaini@unsri.ac.id.



**Bhakti Yudho Suprpto**     was born on February 11th 1975 in Palembang (South Sumatra, Indonesia). He is a graduate of Sriwijaya University of Palembang in major of electrical engineering. His post graduate and doctoral program is in Electrical Engineering of Universitas Indonesia (UI). He is an academic staff of Electrical Engineering of Sriwijaya University of Palembang as a lecture. He concerns in major of control and intelligent system. He can contact at email: bhakti@ft.unsri.ac.id.



# 15%

SIMILARITY INDEX

### PRIMARY SOURCES

- 1 Rana Hassan Bedeir, Rasha Orban Mahmoud, Hala H. Zayed. "Automated multi-class skin cancer classification through concatenated deep learning models", IAES International Journal of Artificial Intelligence (IJ-AI), 2022  
37 words — 1%  
Crossref
- 2 Salah Bouktif, Ali Fiaz, Ali Ouni, Mohamed Serhani. "Optimal Deep Learning LSTM Model for Electric Load Forecasting using Feature Selection and Genetic Algorithm: Comparison with Machine Learning Approaches †", Energies, 2018  
26 words — 1%  
Crossref
- 3 "Artificial Intelligence and Security", Springer Science and Business Media LLC, 2022  
21 words — 1%  
Crossref
- 4 [turcomat.org](http://turcomat.org)  
Internet  
21 words — 1%
- 5 [www.journaltocs.ac.uk](http://www.journaltocs.ac.uk)  
Internet  
19 words — 1%
- 6 Sepp Hochreiter, Jürgen Schmidhuber. "Long Short-Term Memory", Neural Computation, 1997  
18 words — 1%  
Crossref
- 7 Yanzhu Liu, Shreya Dutta, Adams Wai-Kin Kong, Chai Kiat Yeo. "An Image Inpainting Approach to Short-

term Load Forecasting", IEEE Transactions on Power Systems, 2022

Crossref

8 Thanh-Phuong Nguyen, Chao-Tsung Yeh, Ming-Yuan Cho, Chun-Lung Chang, Meng-Jie Chen. 17 words — 1%

"Convolutional neural network bidirectional long short-term memory to online classify the distribution insulator leakage currents", Electric Power Systems Research, 2022

Crossref

9 Waddah Waheeb, Rozaida Ghazali. "A novel error-output recurrent neural network model for time series forecasting", Neural Computing and Applications, 2019 17 words — 1%

Crossref

10 Muhammad Thahir, Alian Sair, Adhitya Rol Asmi. "PERANAN MACHMUD HASJIM DALAM PEMBANGUNAN UNIVERSITAS SRIWIJAYA TAHUN 1994-1999", HISTORIA : Jurnal Program Studi Pendidikan Sejarah, 2020 15 words — 1%

Crossref

11 Salah Bouktif, Ali Fiaz, Ali Ouni, Mohamed Adel Serhani. "Multi-Sequence LSTM-RNN Deep Learning and Metaheuristics for Electric Load Forecasting", Energies, 2020 15 words — 1%

Crossref

12 Garuda.Kemdikbud.Go.Id 14 words — < 1%

Internet

13 ijece.iaescore.com 14 words — < 1%

Internet

14 periodicos.ufv.br 13 words — < 1%

Internet

---

15 Patiyus Agustiansyah, Rizal Sanif, Siti Nurmaini, Irfannuddin, Legiran. "Epidemiology and Risk Factors for Cervical Cancer", Bioscientia Medicina : Journal of Biomedicine and Translational Research, 2021 12 words — < 1%

Crossref

---

16 Nadjib Mohamed Mehdi Bendaoud, Nadir Farah, Samir Ben Ahmed. "Comparing Generative Adversarial Networks architectures for electricity demand forecasting", Energy and Buildings, 2021 11 words — < 1%

Crossref

---

17 Jan-Simon Telle, Nailya Maitanova, Thomas Steens, Benedikt Hanke, Karsten von Maydell, Matthias Grottke. "Combined PV Power and Load Prediction for Building-Level Energy Management Applications", 2020 Fifteenth International Conference on Ecological Vehicles and Renewable Energies (EVER), 2020 10 words — < 1%

Crossref

---

18 Ravi Kant, Poonam Saini, Julee Kumari. "Long-Short Term Memory Auto-Encoder based Position Prediction Model for Fixed-wing UAV during Communication Failure", IEEE Transactions on Artificial Intelligence, 2022 10 words — < 1%

Crossref

---

19 WWW.MDPI.COM 10 words — < 1%

Internet

---

20 "Application of Machine Learning and Deep Learning Methods to Power System Problems", Springer Science and Business Media LLC, 2021 9 words — < 1%

Crossref

---

21 Naqash Ahmad, Yazeed Ghadi, Muhammad Adnan, Mansoor Ali. "Load Forecasting Techniques for 9 words — < 1%

Power System: Research Challenges and Survey", IEEE Access, 2022

Crossref

22 Yi Wang, Dahua Gan, Mingyang Sun, Ning Zhang, Zongxiang Lu, Chongqing Kang. "Probabilistic individual load forecasting using pinball loss guided LSTM", Applied Energy, 2019

Crossref

9 words — < 1%

23 Zuhaila Mat Yasin, Nur Ashida Salim, Nur Fadilah Ab Aziz. "Long Term Load Forecasting using Grey Wolf Optimizer - Artificial Neural Network", 2019 7th International Conference on Mechatronics Engineering (ICOM), 2019

Crossref

9 words — < 1%

24 [downloads.hindawi.com](https://downloads.hindawi.com)

Internet

9 words — < 1%

25 [www.iaeng.org](http://www.iaeng.org)

Internet

9 words — < 1%

26 Alam, S M Mahfuz. "Development of Forecasting and Scheduling Methods and Data Analytics Based Controls for Smart Loads in Residential Buildings", The University of Memphis, 2021

ProQuest

8 words — < 1%

27 Mianshan Cui. "District heating load prediction algorithm based on bidirectional long short-term memory network model", Energy, 2022

Crossref

8 words — < 1%

28 Venkataramana Veeramsetty, D. Rakesh Chandra, Surender Reddy Salkuti. "Short - term electric power load forecasting using factor analysis and long short -

8 words — < 1%

term memory for smart cities", International Journal of Circuit Theory and Applications, 2020

Crossref

---

29 ecor.modares.ac.ir 8 words — < 1%  
Internet

---

30 polen.itu.edu.tr 8 words — < 1%  
Internet

---

31 repository.tudelft.nl 8 words — < 1%  
Internet

---

32 www.mitpressjournals.org 8 words — < 1%  
Internet

---

33 www.preprints.org 8 words — < 1%  
Internet

---

34 Zahra Shafiei Chafi, Hossein Afrakhte. "Short-Term Load Forecasting Using Neural Network and Particle Swarm Optimization (PSO) Algorithm", Mathematical Problems in Engineering, 2021 7 words — < 1%  
Crossref

---

35 Jatin Bedi, Durga Toshniwal. "Deep learning framework to forecast electricity demand", Applied Energy, 2019 6 words — < 1%  
Crossref

---

EXCLUDE QUOTES ON

EXCLUDE SOURCES OFF

EXCLUDE BIBLIOGRAPHY ON

EXCLUDE MATCHES OFF